

# AnMa TECH

*For all your bolting needs*

Report nr.:

36846537-0521

Serial nr.:

7328788

Tool:

HE055-2

Ma min:

0

Ma max:

700

Date:

25-05-2021

Technician:

Glenn van den Berg

Equipment:

LEO2/700 Bar 8140

Pressure (Bar)	Measured (Bar)	Difference %
0	0	0
100	101	0,1
200	200	0,0
300	300	0,0
400	398	-0,3
500	505	0,7
600	598	-0,3
700	702	0,3

Result:

Pressure gauge verified within 1% of full scale value

Signature:




# AnMa TECH

*For all your bolting needs*

Calibration date:	25-05-2021
Calibration due:	25-05-2022

Tool model:	HE055-2
Serial nr.:	7328788

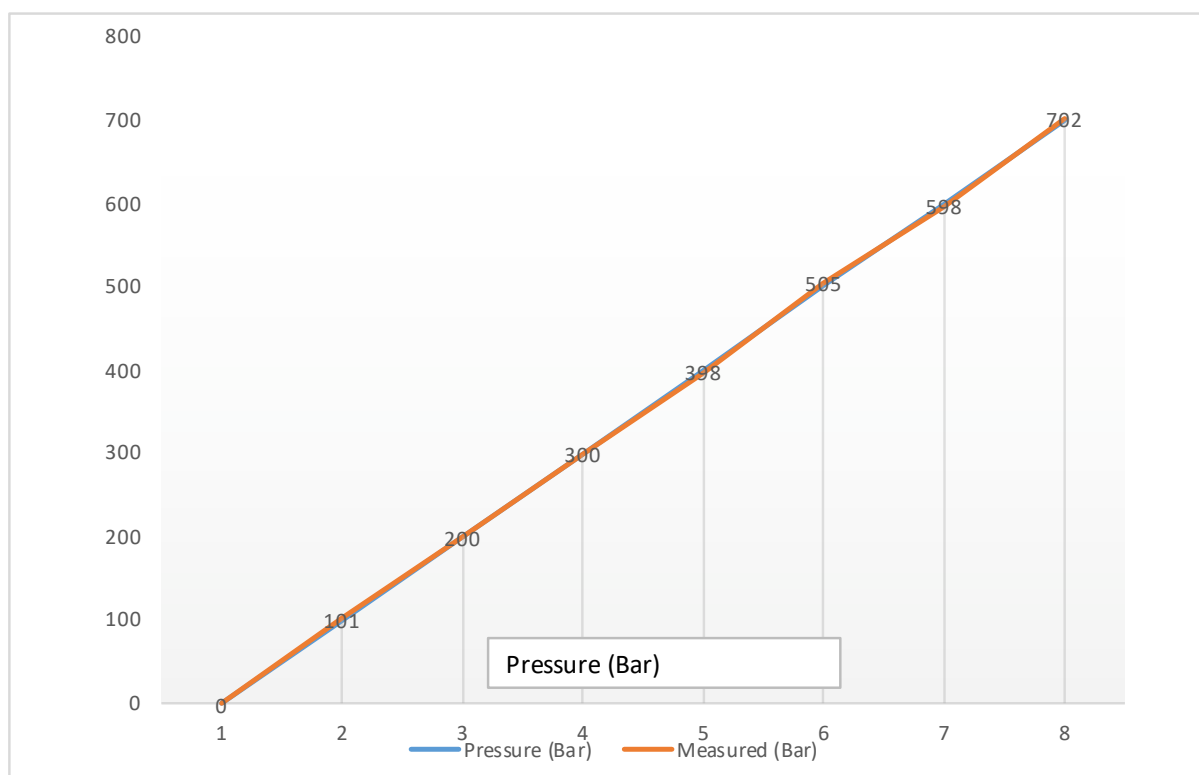

**Disclaimer:**

AnMa TECH BV does not take liability for any damage caused by observations made or remarks noted on this report.

Every check and/or test is a snap shot.

Performed following ISO/IEC 17025:2017

**NEN 3140**  
KEURING

**AnMa TECH**  
*For all your bolting needs*

Report nr.: 36846537-0521 NEN3140  
Serial nr.: 7328788  
Tool: HE055-2

Date: 25-05-2021  
Technician: André van Nijnatten  
Equipment: EazyPat s/n 13H-0311

TEST	RESULTAAT	MEETWAARDE	STATUS
Visuele controle	OK	nvt	GOED
Weerstandbeschermingsleiding	OK	0,07 $\Omega$	GOED
Isolatie weerstand	OK	>19,99 M $\Omega$	GOED
Vervangende lekstroom	OK	0,15mA	GOED

RESULTAAT	OK	nvt	GOED
-----------	----	-----	------

Result:

Signature:

